





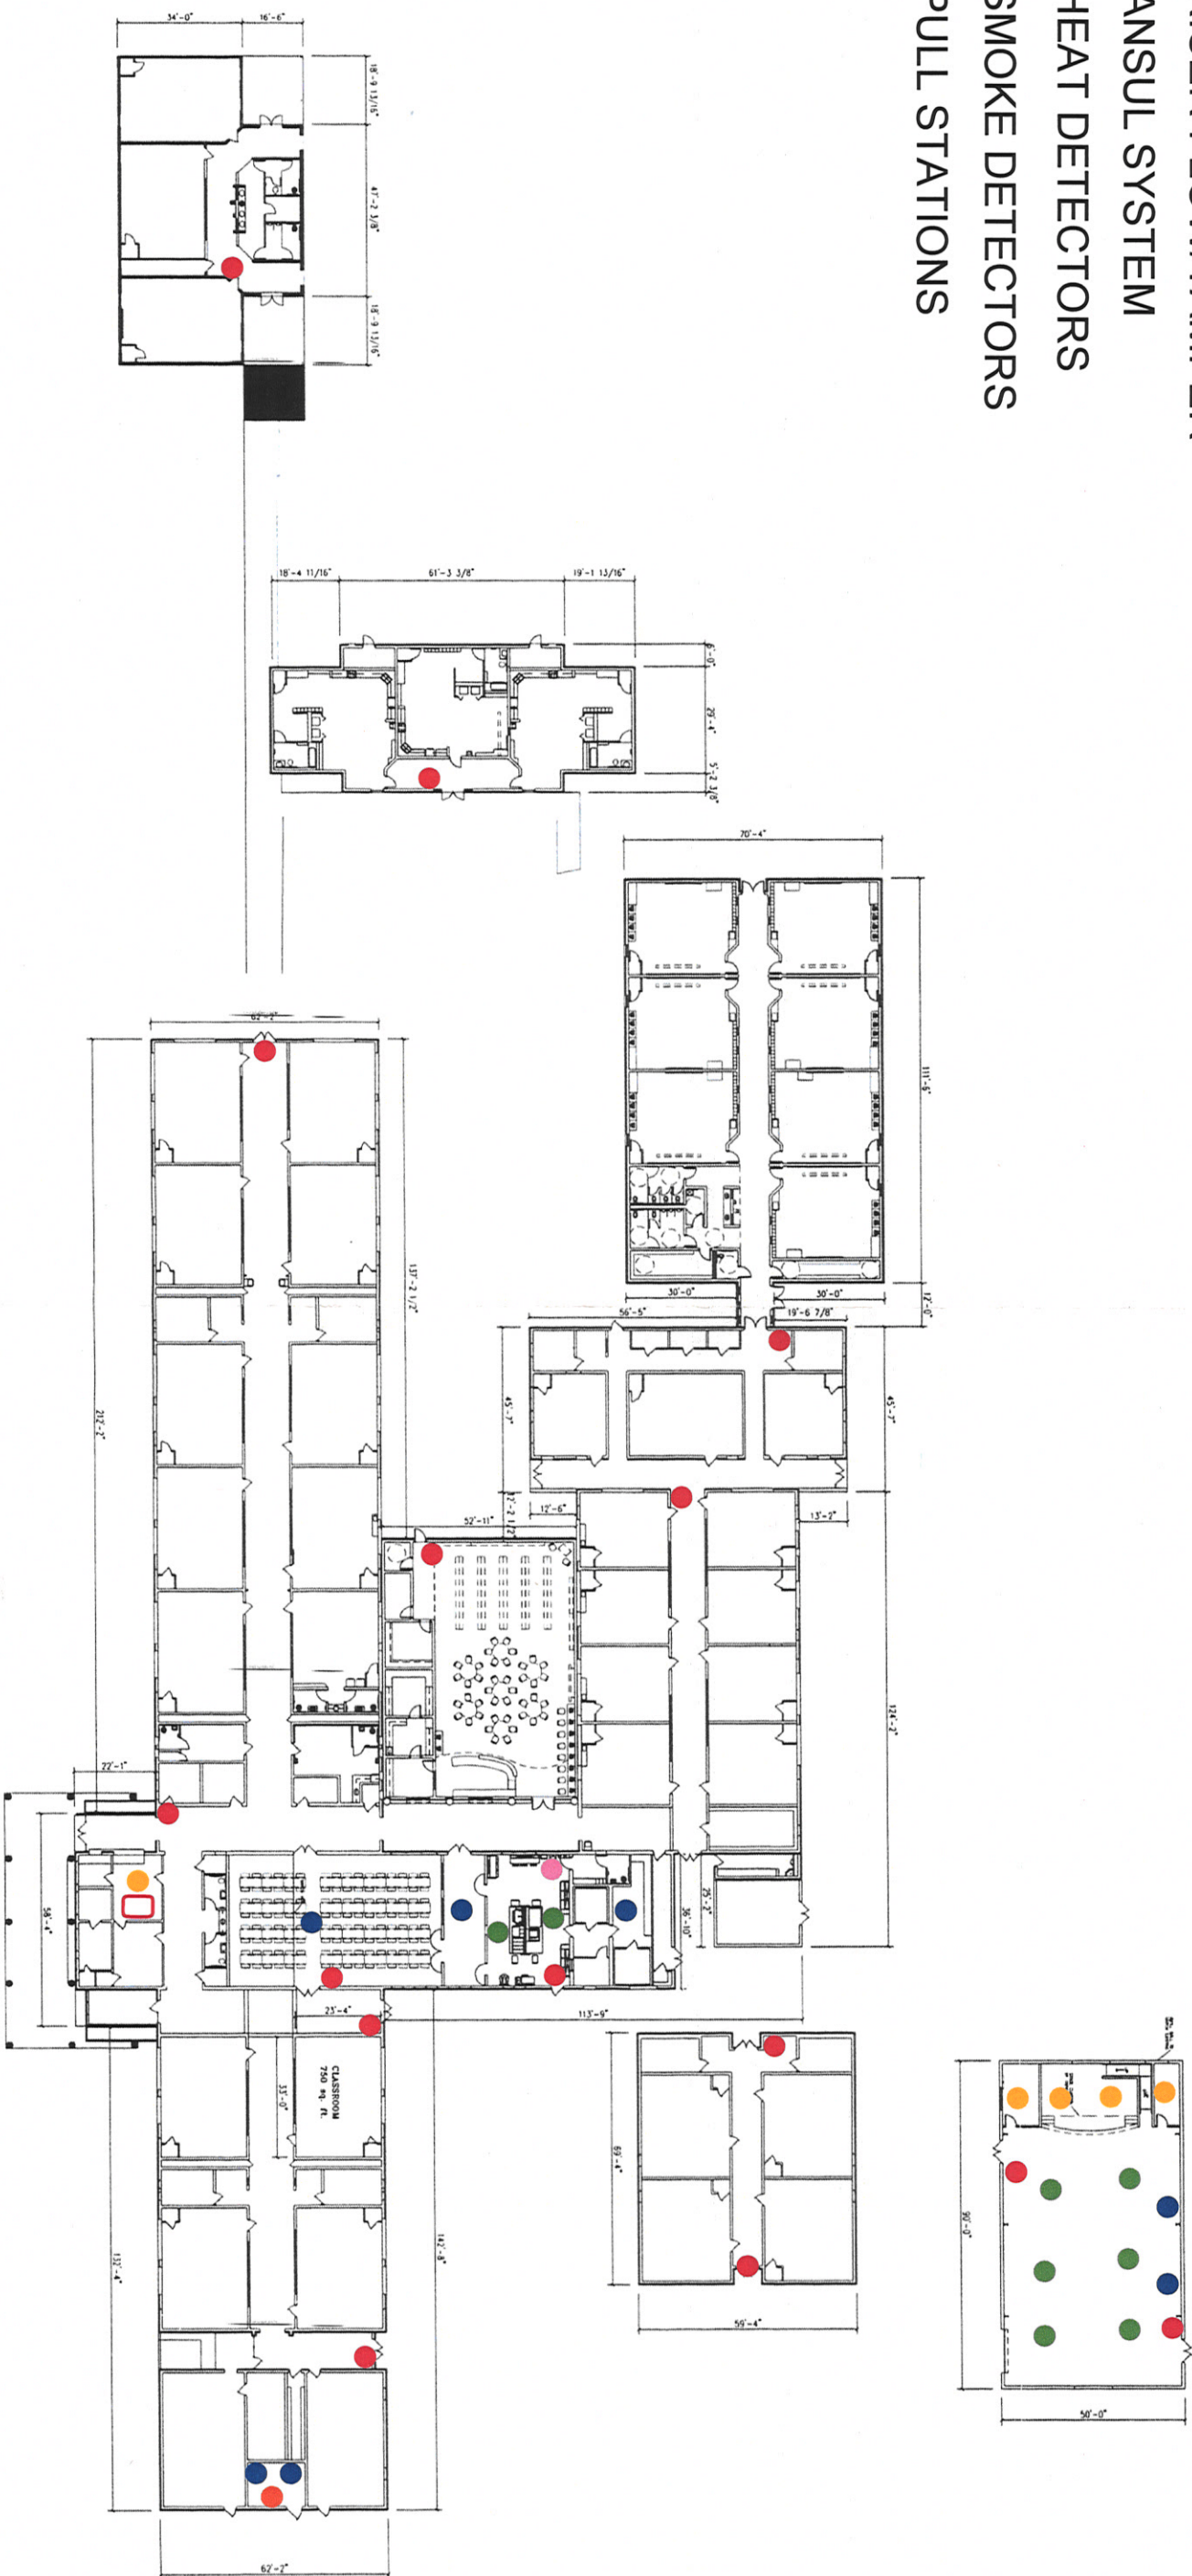


 F.A.C.P.

-  DUCT DETECTORS
-  RISER FLOW/TAMPER
-  ANSUL SYSTEM
-  HEAT DETECTORS
-  SMOKE DETECTORS
-  PULL STATIONS



*NOTE:

- *ALL WIRE MUST BE UV RATED
- *SPEAKER STROBES THROUGHOUT ENTIRE CAMPUS
- *SMOKE DETECTORS ABOVE ALL POWER SUPPLIES AND AMPLIFIERS
- *CONDUIT BUILDING TO BUILDING CONNECTIONS

